

Addressee : **URSA IBERICA AISLANTES SA
CTRA VILARODONA KM 6,7
EL PLA DE SANTA MARIA
43810 TARRAGONA
ESPAGNE**

For the attention of Mr Pedro URIZ

Villeurbanne, 10th December, 2009

Person in charge: **Anne TISSOT**

Function: Project Manager

Signature:

Test Report N° 2914197/2

Version: 00

**Tests on glasswool air conditioning duct
according to EN 13403
Pressure losses tests**

EQUIPMENT ID: P8858 Panel

MANUFACTURER: URSA IBERICA AISLANTES SA

REFERENCE DOCUMENT(S): EN 13403

TESTS PERFORMED BY: Dominique Pugnet

DATE OF TESTS: December 2009

Only the original report printed and signed or a copy certified by CETIAT is valid

CENTRE TECHNIQUE DES INDUSTRIES AÉRAULIQUES ET THERMIQUES

Domaine Scientifique de la Doua - 25, avenue des Arts - BP 52042 - 69603 Villeurbanne Cedex - France
Tél. +33 (0)4 72 44 49 00 - Fax. +33 (0)4 72 44 49 49 - www.cetiat.fr - E. Mail : cetiat.commercial@cetiat.fr

Livraisons : Domaine Scientifique de la Doua - 54, avenue Niels Bohr - 69100 Villeurbanne

Siret 775 686 967 00024 - Ape 731 Z

The signed original report cancels all results and draft documents previously submitted.

Each updated version of the report supersedes all previous ones.

All void copies must be returned to CETIAT or destroyed. We draw your attention of errors incurred by keeping a void copy.

Version	Date	Nature of change	Modified pages
00	10/12/2009	First edition	

Results of reports are the exclusive property of the customer and CETIAT prohibits their distribution to third parties without prior written consent.

Any commercial use of the name CETIAT or of results is subject to CETIAT's prior consent.

This report may be reproduced only in its entirety.

The reports written by CETIAT are valid only for the equipment provided for the test in the specific conditions under which the test was run.

Information concerning the measurement equipment used for the tests is kept in CETIAT's archives.

The use of these results for designing equipments using this material must take into account manufacturing tolerances and real operating conditions. CETIAT cannot be held liable for such use of these results.

The formulas or codes used to predict either the operation of a device in conditions other than those used in the test or the characteristics of similar devices of different dimensions are based on the state of knowledge at the time the results were delivered and are subject to change. The results obtained through these formulas or codes are given as an indication only.

The original copy of the report is given to the customer and a certified copy is kept at CETIAT.

<i>C O N T E N T S</i>

1. INTRODUCTION.....	4
2. SUMMARY OF THE RESULTS.....	5
APPENDIX 1 - DESCRIPTION OF THE TESTS.....	6
APPENDIX 2 - DETAILED RESULTS.....	9

1. INTRODUCTION

The objective of the tests was to characterise the linear pressure losses of an air conditioning duct made in insulation ductboards, reference **P8858**. The report 2914197/1 of the 24th of November deals with the results of previous tests made on same product (erosion and emission of particles, resistance against pressure, air leakage factor and airtightness class).



Figure 1: tested product

Summary of the results is in part 2.


The description of the tests is in APPENDIX 1 -.

The detailed are in APPENDIX 2 -.

The tests were made by Mr Dominique PUGNET.

2. SUMMARY OF THE RESULTS

The Figure 2 presents the values of the linear pressure losses according to air velocity, for the standard conditions (20°C, 101325 Pa), and for a section of 300 mm × 300 mm. The linear pressure losses are due to the roughness of the inner surface of the ductboards and the turbulence possibly created by the links between each board.

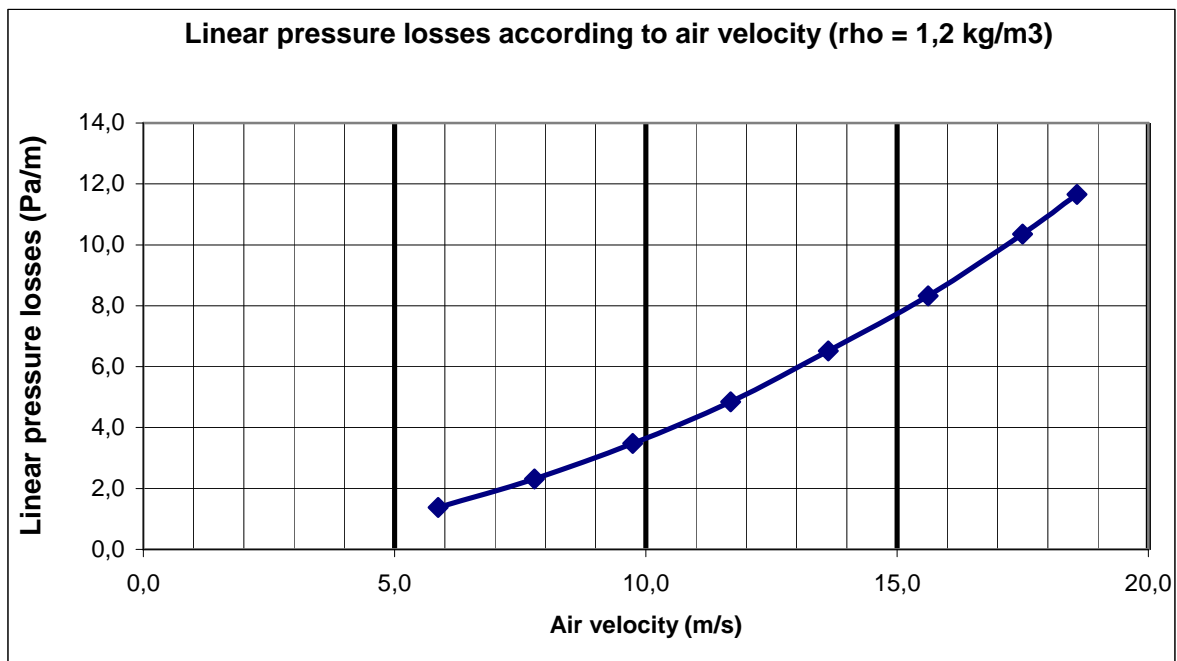

**Figure 2 : Linear pressure losses according to air velocity, for P8858 reference,
300 mm × 300 mm**

APPENDIX 1 - DESCRIPTION OF THE TESTS

The aim of the tests is to determine the linear pressure losses of the duct, due to the roughness of the inner surface of the ductboards and the turbulence possibly created by the links between each board.

The pressure losses tests were made using the samples built for the previous tests :

- 2 m + 2 m L-shaped assembly, section of 300 mm × 300 mm,
- straight duct of 7 modules of 1,16 m of length and section of 300 mm × 300 mm,
- Straight duct of 2 modules of 1.16 m of length and section of 300 mm × 300 mm.

The hydraulic diameter of the duct is then 300 mm.

Upstream of the L – shaped assembly are the fan and the airflow rate measurement device.

The static pressure difference is measured between two points placed on the straight part of the assembly. The distance between these two points is 7.0 m, and includes 6 links between the boards.

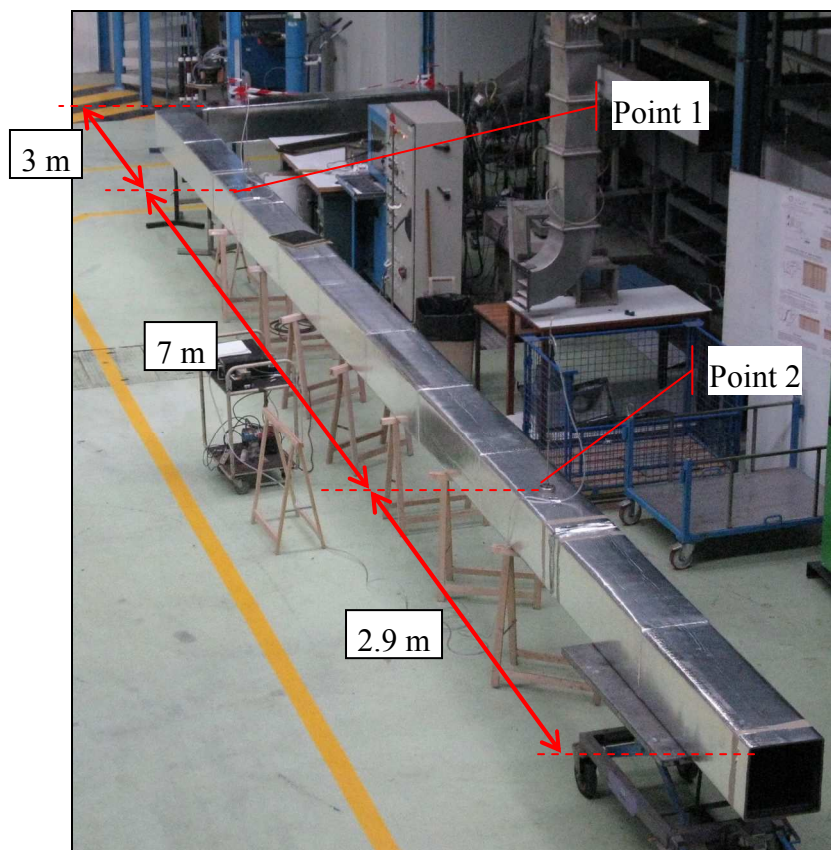


Figure 3 : View of the tests assembly

The first static pressure tap is 3 m behind the 90° - bend, that is to say 10 hydraulic diameters. The static pressure is measured with a Pitot probe in the centre of the duct. Before the measurements, the homogeneity of the static pressure was checked for the air velocity of 12 m/s, at 9 different points in the same section.



Figure 4 : Position of the Pitot Probe, point 1

The static pressure difference between the point 1 and the point 2 is measured for different airflow rates in the duct. For each point of the curve, the following parameters are measured :

- Atmospheric pressure,
- Air temperature,
- Airflow rate,
- Relative humidity,
- Static pressure difference.

As the average air velocity is the same at point 1 and at point 2, the static pressure difference corresponds to the pressure losses (the dynamic pressure is the same at point 1 and at point 2).

The results are then used to determine :

- The Reynolds number Re ,
- The friction coefficient λ ,
- The pressure losses according to the airflow rate in standard conditions (air temperature = 20°C, Pressure = 101325 Pa).

With :

$$Re = \frac{\rho V D_h}{\mu} \quad \text{And} \quad \Delta P = \frac{\lambda}{D_h} \times L \times \frac{1}{2} \times \rho \times V^2$$

Re : Reynolds number, adimensional

ρ : absolute density, in kg/m^3

V : Average air velocity in the duct, in m/s

D_h : hydraulic diameter of the duct, in m

μ : dynamic air viscosity, in $\text{Pa}\cdot\text{s}$

λ : friction coefficient, adimensional

L : length of the duct, in m

APPENDIX 2 - DETAILED RESULTS

Measurements

	Airflow rate	Temperature	Atmospheric pressure	Dew point temperature	Pressure losses
	Qv	T	Patm	Td	ΔP
	m ³ /h	°C	Pa	°C	Pa
1	1948	20,4	99232	10,4	9,6
2	2583	20,3	99240	10,4	16,2
3	3234	20,4	99250	10,5	24,3
4	3886	20,6	99272	10,5	33,9
5	4545	21,1	99285	10,5	45,6
6	5212	21,3	99300	10,6	58,3
7	5859	21,9	99316	10,6	72,4
8	6232	22,2	99326	10,6	81,6

Calculations for the test conditions

	Air velocity	Pressure losses	Absolute density	Dynamic viscosity	Reynolds number	friction coefficient	Linear pressure losses
	V	ΔP	ρ	μ	Re	λ	ΔP/L
	m/s	Pa	kg/m ³	Pa.s	-	-	Pa/m
1	6,01	9,6	1,172	1,81E-05	1,2E+05	0,0195	1,4
2	7,97	16,2	1,172	1,81E-05	1,5E+05	0,0186	2,3
3	9,98	24,3	1,172	1,81E-05	1,9E+05	0,0178	3,5
4	11,99	33,9	1,172	1,82E-05	2,3E+05	0,0173	4,8
5	14,03	45,6	1,170	1,82E-05	2,7E+05	0,0170	6,5
6	16,09	58,3	1,169	1,82E-05	3,1E+05	0,0165	8,3
7	18,08	72,4	1,167	1,82E-05	3,5E+05	0,0163	10,3
8	19,24	81,6	1,166	1,82E-05	3,7E+05	0,0162	11,7

Calculations for the standard conditions (20°C, 101325 Pa)

	friction coefficient	Absolute density	Dynamic viscosity	Air velocity	Pressure losses
	λ	ρ	μ	V	ΔP
	-	kg/m ³	Pa/s	m/s	Pa
1	0,0195	1,2	1,81E-05	5,87	9,4
2	0,0186	1,2	1,81E-05	7,78	15,8
3	0,0178	1,2	1,81E-05	9,74	23,7
4	0,0173	1,2	1,81E-05	11,69	33,0
5	0,0170	1,2	1,81E-05	13,63	44,2
6	0,0165	1,2	1,81E-05	15,62	56,4
7	0,0163	1,2	1,81E-05	17,49	69,7
8	0,0162	1,2	1,81E-05	18,58	78,3

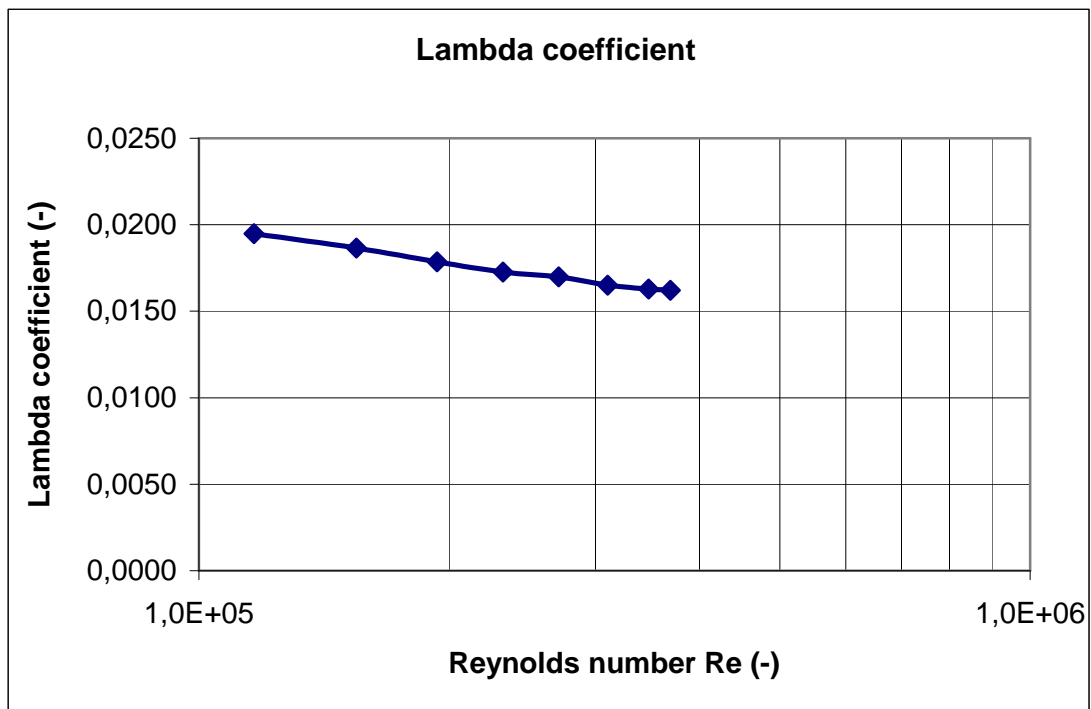


Figure 5 : Friction coefficient according to Reynolds number

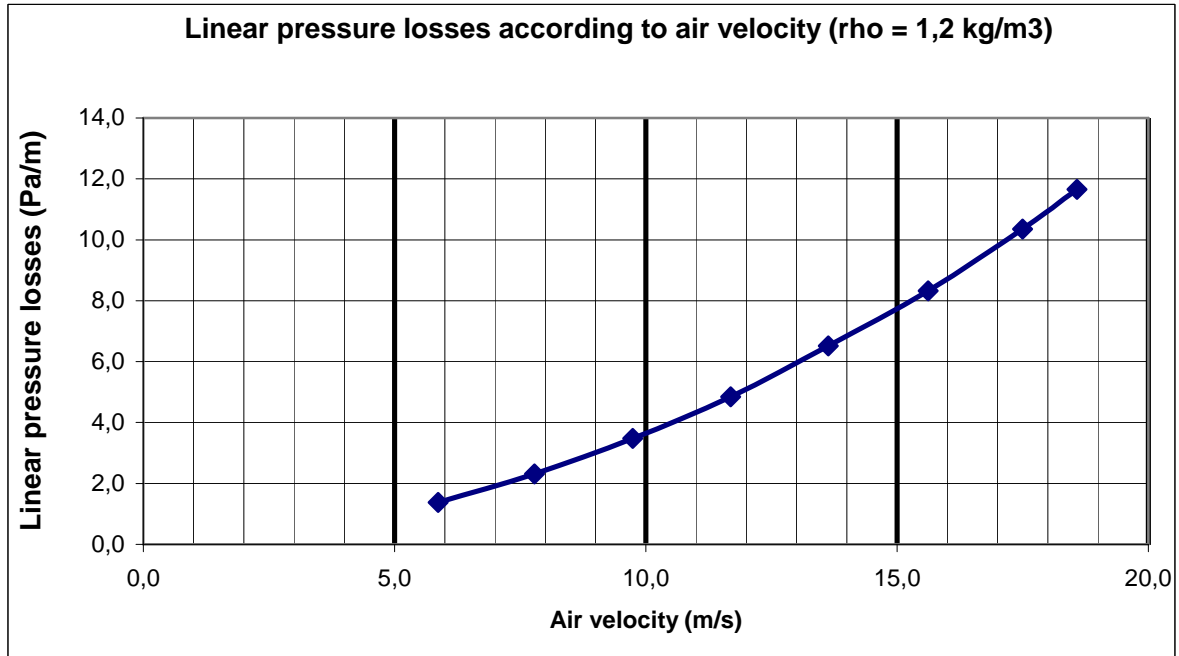


Figure 6 : Linear pressure losses according to air velocity